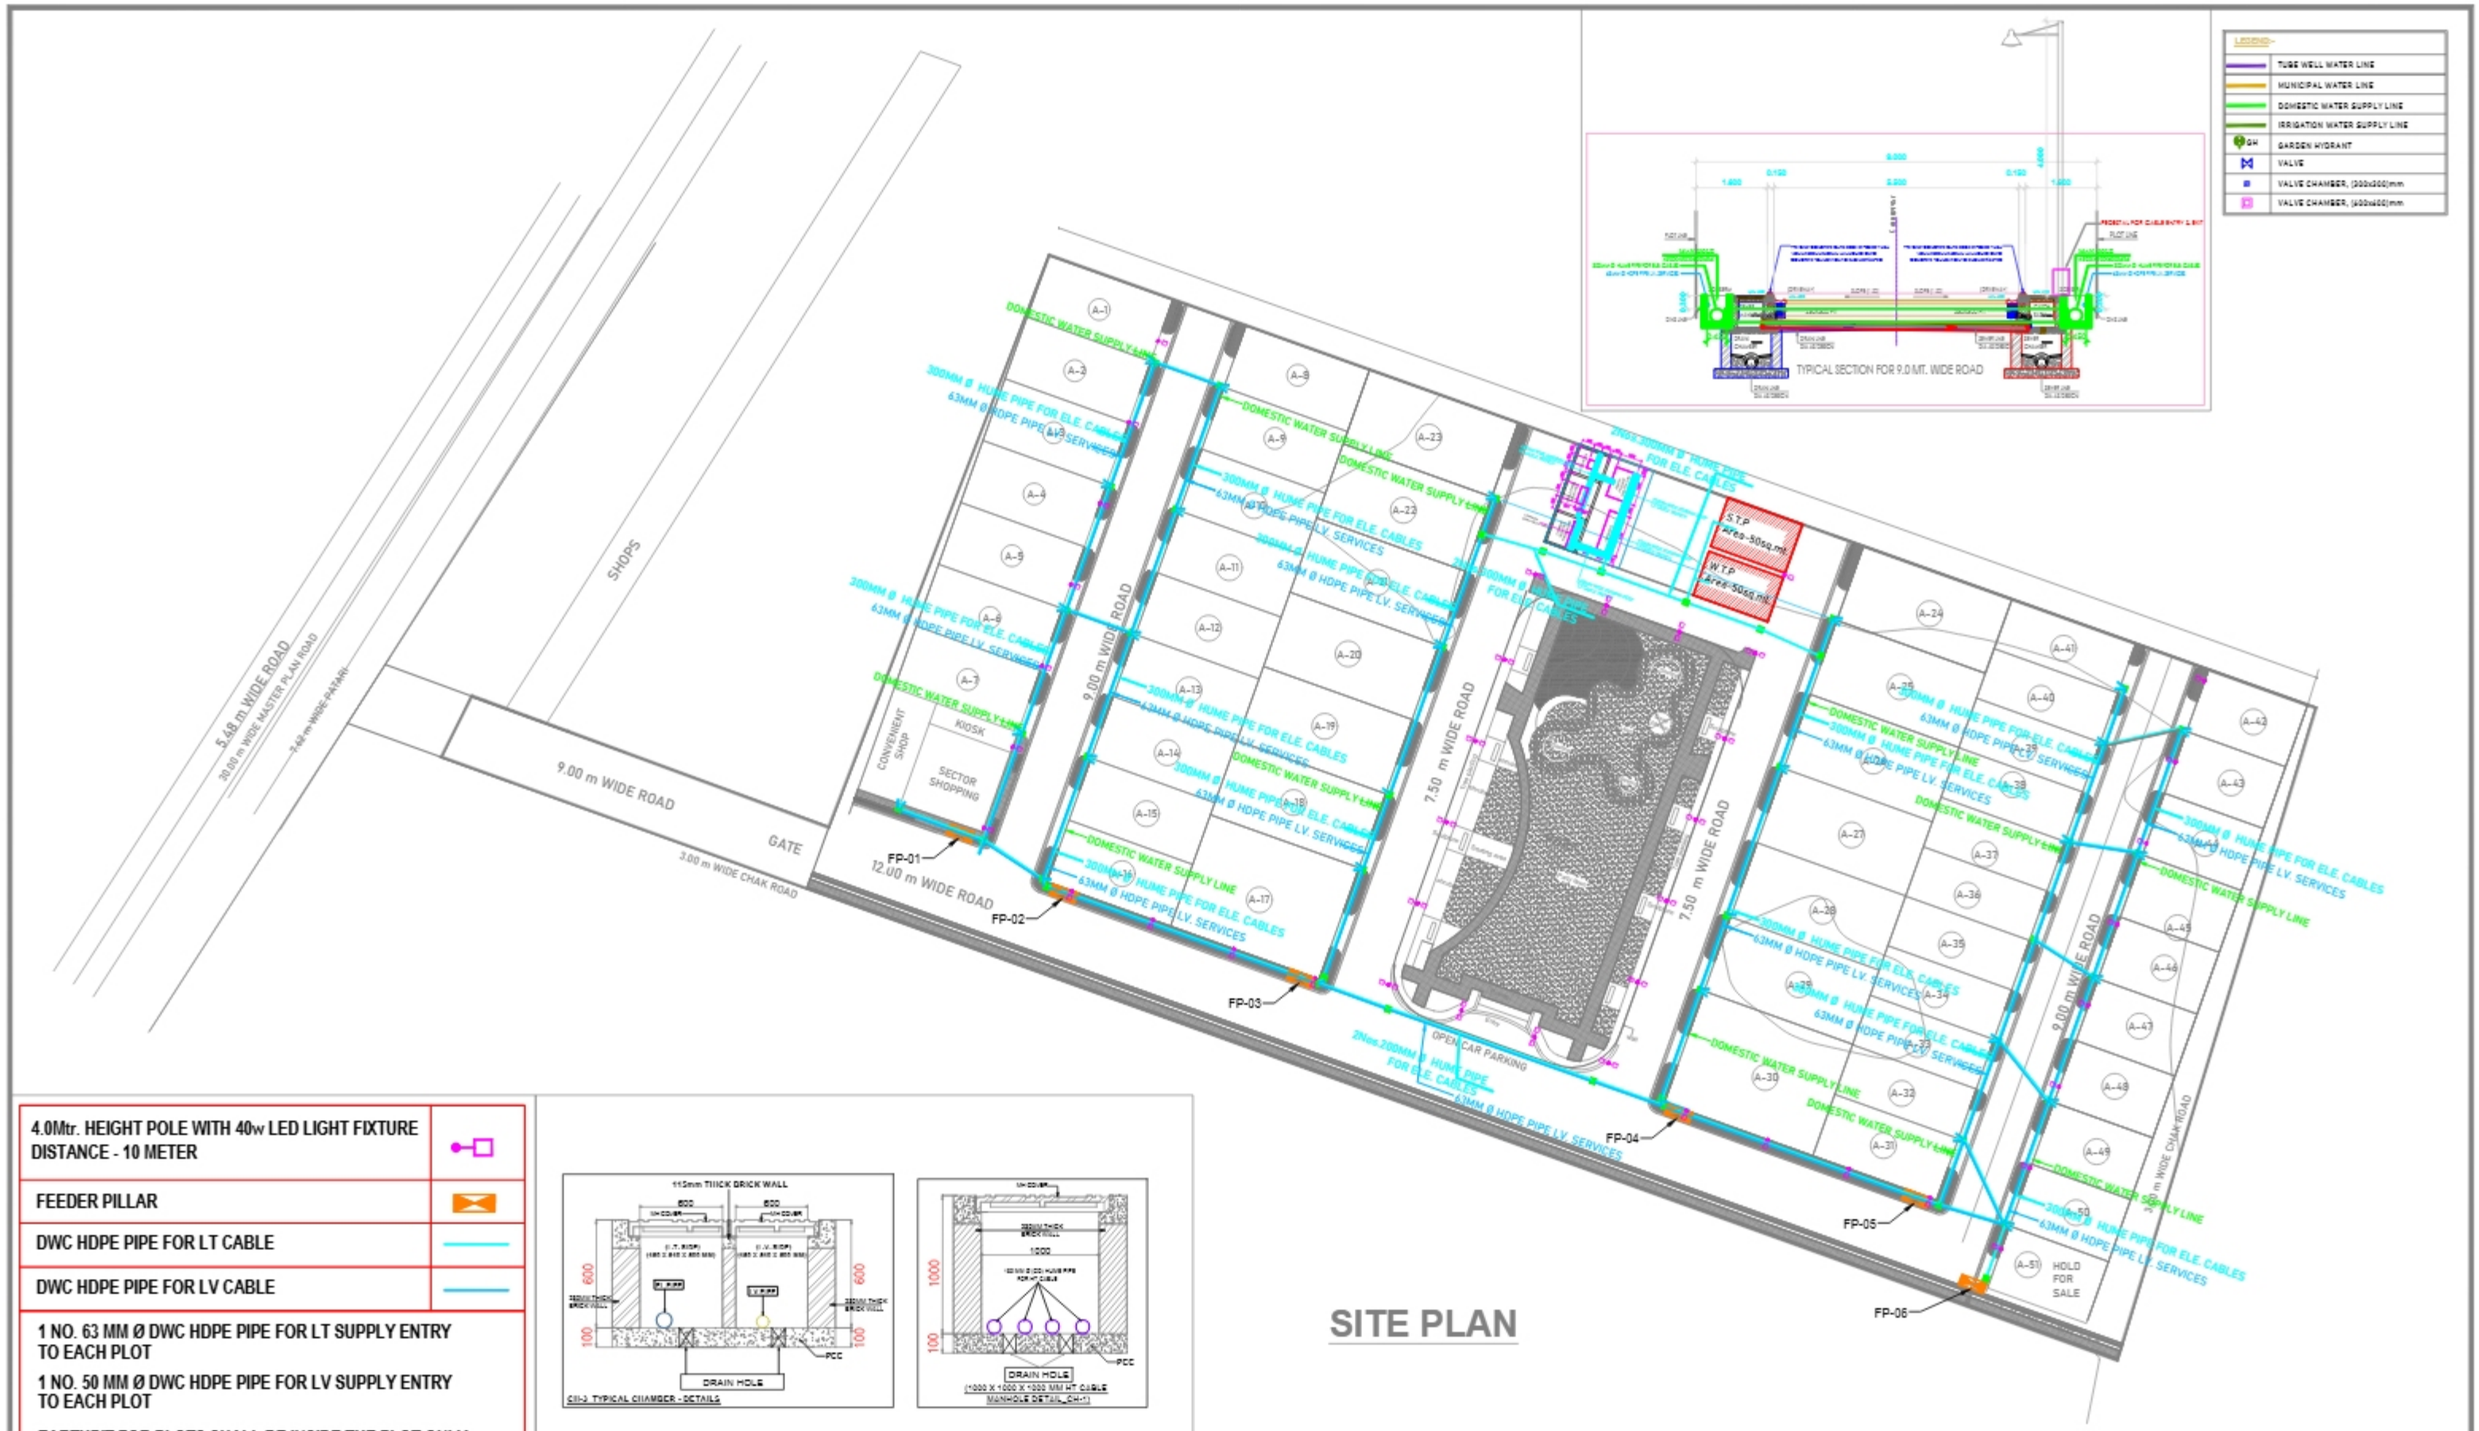

SITE PLAN

4.0Mtr. HEIGHT POLE WITH 40w LED LIGHT FIXTURE DISTANCE - 10 METER	
FEEDER PILLAR	
DWC HDPE PIPE FOR LT CABLE	
DWC HDPE PIPE FOR LV CABLE	
1 NO. 63 MM Ø DWC HDPE PIPE FOR LT SUPPLY ENTRY TO EACH PLOT 1 NO. 50 MM Ø DWC HDPE PIPE FOR LV SUPPLY ENTRY TO EACH PLOT EARTHPIT FOR PLOTS SHALL BE INSIDE THE PLOT ONLY	

CH-2 TYPICAL CHAMBER - DETAILS

MANHOLE DETAIL_CH-1

GENERAL NOTES
1. All designs are based on applicable standards including:
National Building Code of India 2016 (Part IX – Plumbing)
IS 1172, IS 2065, CPHEEO Manual
Relevant local authority norms and bye-laws
2. Pipe routing, sizing, and equipment locations are indicative and to be verified on-site prior to installation. Final execution shall be adjusted to suit actual site conditions.
3.The drawings must be read in conjunction with architectural, structural, electrical, HVAC, and other relevant services drawings.
4. All dimensions are in millimetres unless otherwise specified.
5. Contractor shall verify all site dimensions, levels, and coordinates before starting execution.
6. All materials, valves, pumps, fixtures, and equipment shall be ISI marked or approved as per project specifications and local standards.
7. Pressure testing of pipelines (hydrostatic and air) shall be carried out as per IS code and shall be witnessed by the Engineer/Consultant.
8. All installations shall be carried out by licensed agencies as per statutory authority norms.
9. These drawings are conceptual/design intent and not to be used for statutory submission unless signed by the licensed architect or authority-approved engineer.
10. Accurate Design Consultants shall not be held liable for modifications, deviations, or execution errors done without written design change approval.

NO.	DATE	BY	SEND TO
3.			
2.			
1.			

ISSUES

NO.	DATE	DESCRIPTION
3.		
2.		
1.		

REVISION LOG

ELECTRICAL CONSULTANT
SARIMANYA E2E
END TO END TECHNICAL SOLUTIONS
Basement, Plot No. 21, Pocket -1, Near MCU School, Sector -13, Dwarka,New Delhi-110078
E-Mail:sarimanyae2e@gmail.com

CLIENT
GEO SPAR DEVELOPERS

ARCHITECT
SIGNITIVE DESIGN STUDIO
ARCHITECT : ROHIT DHINGRA
Contact- 9810683707,8810352620
SIGNITIVEDESIGNSTUDIO@GMAIL.COM
DELHI : GURGAON

PROJECT
PROPOSED LAYOUT PLAN OF " AERO VISTA " COLONY THROUGH SIVANTRAJ SERVICES INDIA LIMITED AT PLOT NO.- 1072 , 1073 ,1074 ,1075 MAUZA/VILL. - SARETHI, TEHSIL - SADAR DISTT. - AYODHYA

DWG TITLE
SITE PLAN
EXTERNAL ELECTRICAL LAYOUT

☐ FOR TENDER/ MOCK UP
☐ FOR INFORMATION
☐ FOR EXECUTION
■ FOR APPROVAL

DEALT BY	K.SINGH	CHECKED BY	S.V.G
DATE	01.08.2025	SCALE	1:350 @ A1
DWG. NO.	EL-100(EXT.)	TYPE	REV. NO. R0