

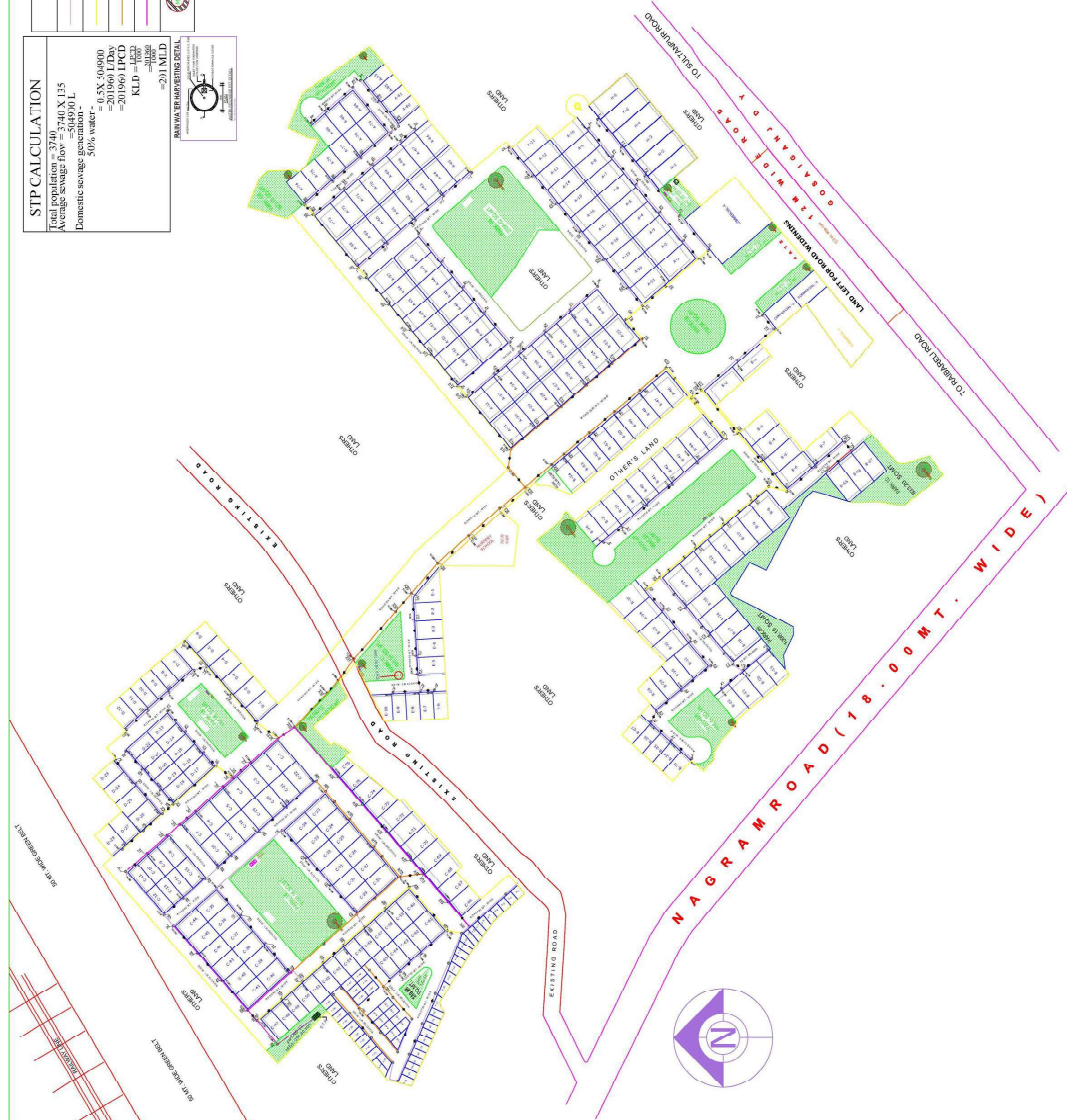


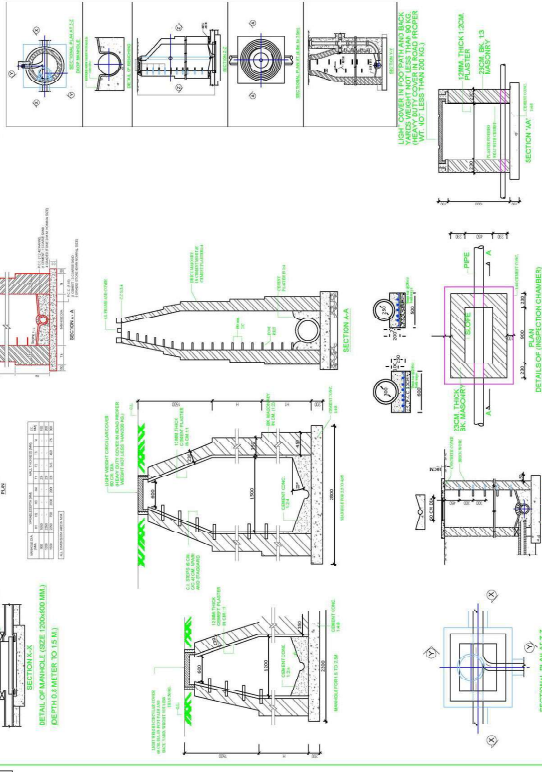

STP CALCULATION		LEGEND	
Total population = 3740		—	200 MM DIA PIPE
Average sewage flow = 50400 L/15		—	250 MM DIA PIPE
Domestic sewage generation = 50% water	0.3X 60800	—	300 MM DIA PIPE
	=20960 L/Day	—	400 MM DIA PIPE
	=20960 IPD	—	
	KLD = 1000	—	
	→ 1000	—	
	→ 201 MLD	—	
		—	MAIN-POLE
PRAJWALA MANUFACTURING DETAIL			

LEGEND	
	200 MN DIA PIPE
	250 MN DIA PIPE
	300 MN DIA PIPE
	400 MN DIA PIPE
	MANHOLE

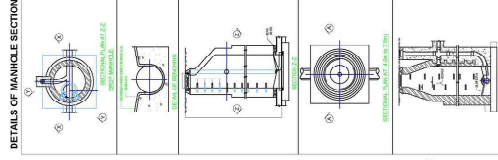

PROPOSED/REVISED LAYOUT PLAN FOR SHITAL INFRADEVELOPERS PVT. LTD. THROUGH ITS DIRECTOR MR. VIMAL KUMAR ON MIN. KHASARA NO.-342 TO 359, 366 TO 368, 370, 371, 396, 398, 399, 402 TO 414, 416, 419 TO 424, 427, 429, 430, 432, 433, 436 TO 442, 445, 470 SITUATED AT VILAGE SEVAI, NAGRAM ROAD, TEHSIL SAROJINI NAGAR, LUCKNOW

DRAWING TITLE
SEWER LINE LAYOUT

OWNER'S

Satish Infra Developers Pvt. Ltd.
Managing Director

ARCHITECT