
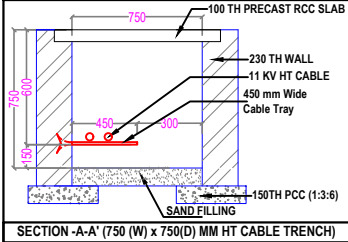


**LEGEND :**

S. No.	SYMBOL	DESCRIPTION
1.		FEEDER PILLAR
2.		HDPE (DWC) PIPE FOR LT CABLE
3.		HDPE (DWC) PIPE FOR LV CABLE
4.		CHAMBER 750 x 750 x 750 MM (FOR L.T. CABLES OUTLET)
5.		CHAMBER 1015 x 450 x 600 MM (FOR ELECTRICAL & L.V. CABLES OUTLET)

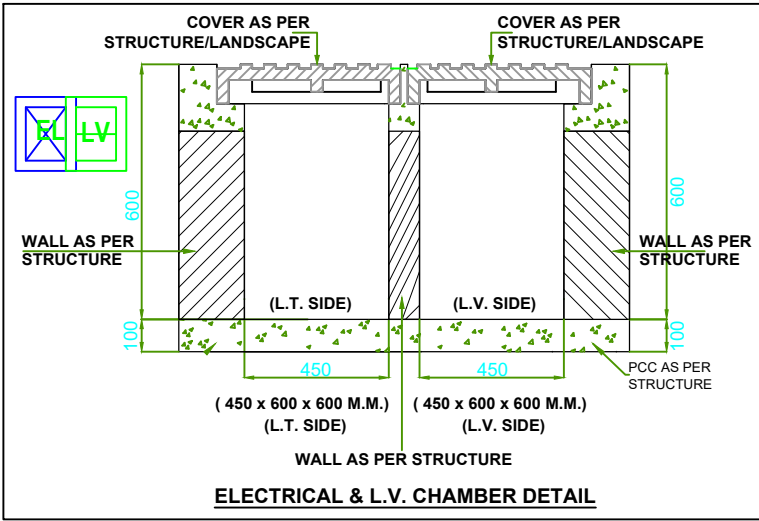

**NOTES :**  
 IT IS DESIRED FROM THE CONTRACTOR THAT HE SHOULD PREPARE SHOP DRAWING BEFORE STARTING THE WORK. FOR ALL SUBSTATION EQUIPMENTS, PANEL, CABLE LAYOUT ETC.

- NOTES :**
- 1) Clear height of 11 KV Meter room shall be minimum 3.2 mtr. below clear beam.
  - 2) Plinth Level of Meter room & VCB room shall be 450 mm above final finished ground level.
  - 3) Trench detail shall be finalized after receiving foundation detail of HT Meter Panel & 11 KV VCB Panel.
  - 4) CSS & DG SETS FOUNDATION SHALL BE GIVEN BY VENDOR.

Rev. No.	Date	Revision

Project : **KING'S CREST AT BAREILLY**

Title : **ELECTRICAL DRAWING**

Subtitle : **ELECTRICAL & LV PIPE LAYOUT**

Drawing Released For :  
 APPROVAL     SUBMISSION  
 ADVANCE COPY     CONSTRUCTION

Drg. No : KC / EK / PL - 04

Scale : \_\_\_\_\_

Date : Aug 2025

Ckd By : \_\_\_\_\_

CLIENT : \_\_\_\_\_

Architect : **STUDIO DESIGN VIEWS**  
 First Floor, Design Complex, Pilibith Road, Bareilly  
 MB. 0581-2540554, +91-8396815714  
 WEBSITE : www.studiodesignviews.com

Services Consultant : **graft studio**  
 Shop no. 09, Shri Jagdamba Market  
 Rithala, Rohini, Delhi, 110085